
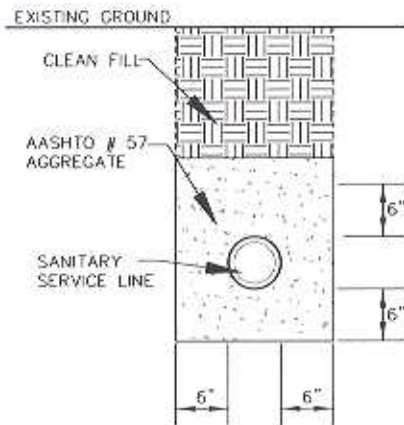
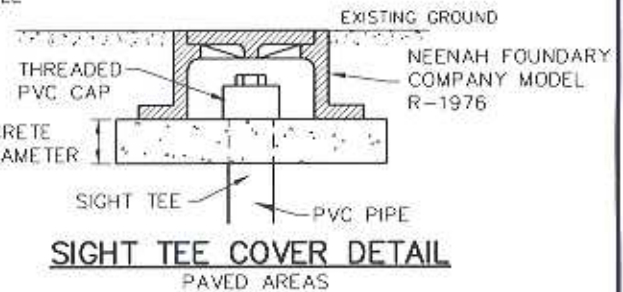


PVC THREADED CAP TO BE USED IN LAWN AREAS AND SHALL BE FLUSH WITH EXISTING SURFACE. IN PAVEMENT AREAS THE SIGHT TEE SHALL BE PROTECTED WITH A NEENAH FOUNDRY R-1976 FRAME AND CASTING SET ON A 4" CONCRETE PAD.

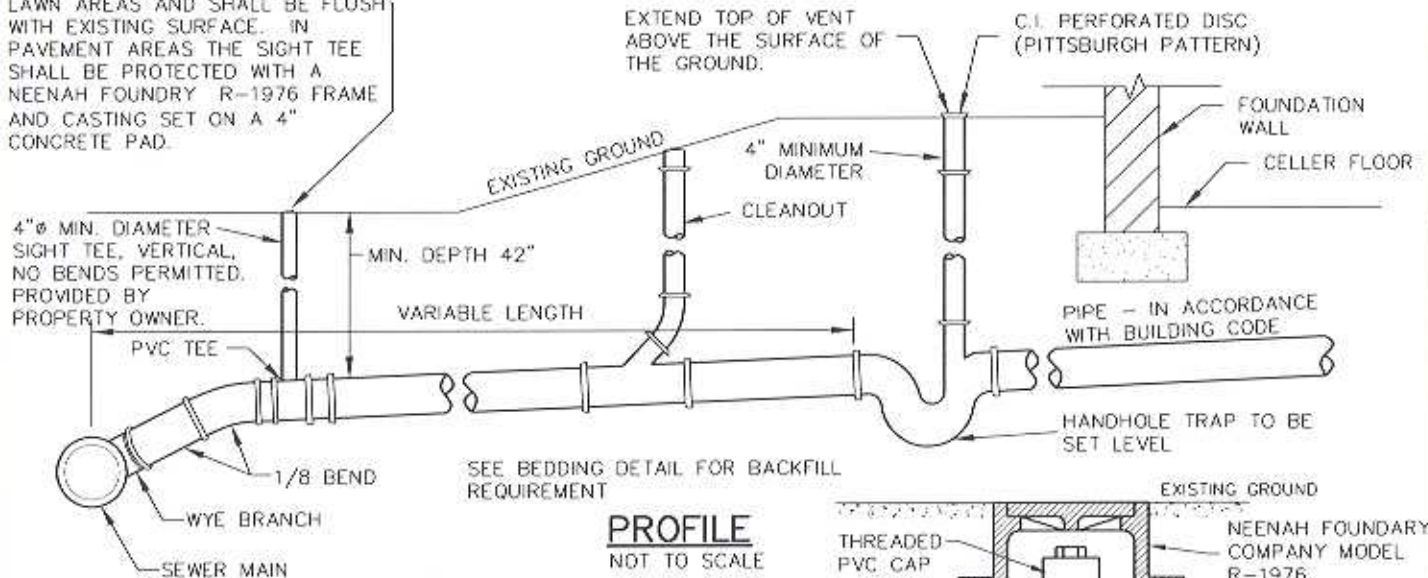

LATERAL BEDDING DETAIL

Not To Scale

NOTE:

- 1.) A TEST TEE MUST BE PROVIDED FOR THE AIR TESTING OF THE LATERAL.
- 2.) NO ROOF, STORM, CELLAR SEEPAGE, SURFACE WATER OR GROUND WATER OF ANY NATURE SHALL BE ALLOWED TO ENTER THE SEWER SYSTEM. DYE AND/ OR SMOKE TESTING WILL BE PERFORMED BY THE AUTHORITY WHERE REQUIRED.
- 3.) LATERAL MUST BE INSPECTED AND APPROVED BY THE AUTHORITY & BUILDING INSPECTOR PRIOR TO BACKFILL.
- 4.) PIPE FITTINGS SHALL MEET THE REQUIREMENTS OF ASTM SPECIFICATIONS D. 1785 FOR SCH 40 ASTM D 3034 PVC DR 35.
- 5.) THE MINIMUM PIPE SLOPE FOR A 4" DIAMETER PIPE SHALL BE 1/4" PER FOOT. FOR SLOPES LESS THAN 1/4" PER FOOT 6" DIAMETER PIPE SHALL BE USED. THE MINIMUM SLOPE FOR 6" DIAMETER PIPE SHALL BE 1/8" PER FOOT.
- 6.) CLEANOUTS REQUIRED EVERY 100'.
- 7.) IF FRESH AIR VENT IS WITHIN 4' STRUCTURE, THE FRESH AIR VENT MUST BE LOCATED A MINIMUM OF 10' AWAY FROM ANY FRESH AIR INTAKE TO SAID STRUCTURE.

STANDARD CONNECTION TO SANITARY SEWER

ADOPTED BY THE BOARD:

Not To Scale

REVISIONS:
4-25-05-SIGHT TEE

CECIL TOWNSHIP MUNICIPAL AUTHORITY CONSTRUCTION STANDARDS

THE GATEWAY ENGINEERS, INC.

SC-10